

Data sheet

MULTICAL® 803

Heat and cooling meter for trade and industry

- Fully programmable data logger with minute loggers
- 2 second integration interval
- 4 communication modules
- 7 or 8 digit display resolution
- User-friendly interface with 3 push buttons
- Large backlit display
- IP65 density
- 6-year battery backup
- Auto Detect of Kamstrup's ULTRAFLOW®
- Auto Detect of Pt-temperature sensor



MID 2014/32/EU



EN 1434

DK-BEK 1178 - 06/11/2014



EN 1434

Contents

Description	2
Mechanical design	3
Mechanical data	3
Approved meter data	4
Accuracy	4
Dimensioned sketches	5
Electrical data	6
Product variants	8
Meter configuration	10
Information code types in display	11
Accessories	12

Description

MULTICAL® 803 is a robust and all-round calculator, suitable as heat meter, cooling meter or bifunctional heat/cooling meter together with 1 or 2 flow sensors and 1, 2, 3 or 4 temperature sensors. The meter is intended for energy measurement in almost all types of thermal installations where water is used as the energy-conveying medium.

MULTICAL® 803 can, in addition to heat and cooling measurement, be used for leakage monitoring, permanent performance monitoring, power, flow and temperature limiter with valve control as well as for energy measurement in both open and closed systems.

According to EN 1434 and MID, MULTICAL® 803 can be designated as a "calculator" with separate type approval and verification. The MULTICAL® 803 calculator top can be separated from the connection base by means of a 4 mm Allen wrench when the installation seals have been broken.

MULTICAL® 803 has 2 flow sensor inputs that can be used for both electronic and mechanical flow sensors. The pulse value can be configured from 0.001 to 300 pulses/liter, and the calculator can be configured for all nominal flow sensor sizes from 0.6 to 15,000 m³/h. By default, the calculator is supplied with galvanically coupled flow sensor inputs that fit ULTRAFLOW® and, for example, reed switches. In addition, a connection PCB with 2 galvanically isolated flow sensor inputs can also be supplied.

The accumulated heat energy and/or cooling energy can be displayed in kWh, MWh, GJ or Gcal, all in the form of 7 or 8


significant digits plus measuring unit. The display has been specially designed with a view to obtaining long lifetime and sharp contrast in a wide temperature range and, by default, MULTICAL® 803 has backlit display.

MULTICAL® 803 can be mains-supplied either by 24 VAC or 230 VAC. A built-in battery backup also ensures that the meter continues the energy measurement for 6 years in case of a voltage failure. Furthermore, it is possible to connect a battery backup to module slot M1 by which, for example, M-Bus or wM-Bus will continue to operate during a voltage failure.

In designing MULTICAL® 803, great importance has been attached to flexibility through programmable functions and plug-in modules in order to secure optimum use in a wide range of applications.

Auto Detect UF enables the exchange of ULTRAFLOW® X4 on MULTICAL® 803 without the need for reconfiguration (change of the CCC code). MULTICAL® 803 can automatically adjust the pulse value and qp to match the connected ULTRAFLOW® X4 X4. Auto Detect UF is active with CCC code 8xx and is initiated when the calculator top and base are assembled. In addition, MULTICAL® 803 has automatic conversion between Pt100 and Pt500 sensors via Auto Detect Pt. The meter even detects the type of the connected temperature sensor. However, all connected sensors must be of the same type.

Mechanical design

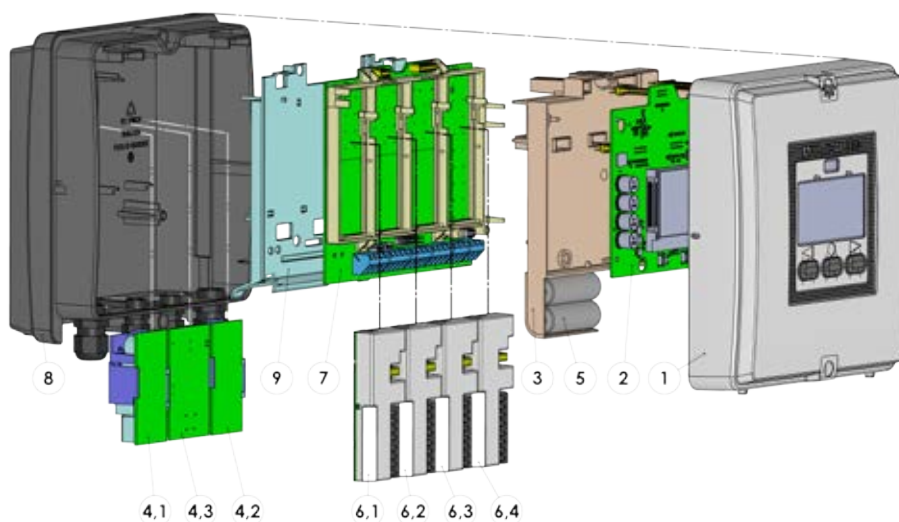

- | | | | |
|-----|---|-----|---|
| 1 | Top cover with front keys and laser engraving | 6.1 | Module slot M1 |
| 2 | PCB with microcontroller, display, etc. | 6.2 | Module slot M2 |
| 3 | Verification cover (may only be opened at an authorised laboratory) | 6.3 | Module slot M3 |
| 4.1 | Mandatory power supply | 6.4 | Module slot M4 |
| 4.2 | Optional power supply | 7 | Connection PCB |
| 4.3 | Optional power supply (isolated 24 VDC) | 8 | Base cover with cable glands |
| 5 | Backup battery | 9 | Power supply cover (only authorized personnel must remove this) |

Mechanical data

Weight	1150 g incl. backup battery
Ambient temperature	5...55 °C. Condensing, closed location (indoor installation)
Protection class	IP65
Media temperatures ULTRAFLOW®	2...130 °C

At medium temperatures below the ambient temperature or above 90 °C in flow sensor, wall-mounting of the calculator is recommended.

Medium in ULTRAFLOW®	Water (district heating water as described in CEN TR 16911 and AGFW FW510)
Storage temperature	-25...60 °C (drained flow sensor)
Connection cable	M12: ø3...8 mm M16: ø4...10 mm
Supply cable	ø4...10 mm

Materials

Cast composite parts	Thermoplastic, PC 10 % GF
Gasket	Neoprene rubber
Push buttons	EPDM rubber

Approved meter data

Approvals

- Heat meter approval DK-0200-MI004-042
 - Temperature range θ : 2 °C...180 °C
 - Differential area $\Delta\theta$: 3 K...178 K
- Cooling meter TS 27.02 013
 - Temperature range θ : 2 °C...180 °C
 - Differential area $\Delta\theta$: 3 K...178 K
- Bifunctional heat/cooling meter Marked with DK-0200-MI004-042 and TS 27.2 013 as well as yearly mark of MID
 - Temperature range θ : 2 °C...180 °C
 - Differential range $\Delta\theta$: 3 K...178 K

The stated minimum temperatures are related to the type approval.
The meter has no cut-off for low temperature and thus measures down to 0.01 °C and 0.01 K.

Standards

EN 1434:2015

EU directives

Measuring Instrument Directive, Low Voltage Directive, Electromagnetic Compatibility Directive, RoHS Directive, Pressurised Equipment Directive

EN 1434 designation

Environmental classes A and C

MID designation

- Mechanical environment Classes M1 and M2
- Electromagnetic environment Classes E1 and E2

Temperature sensor connection

- Type 603-A Pt100 or Pt500 – EN 60 751, 2-wire or 4-wire connection


Accuracy

Heat meter components	MPE according to EN 1434-1	Typical accuracy
MULTICAL® 803	$E_c = \pm [0.5 + \Delta\theta \text{ min}/\Delta\theta] \%$	$E_c = \pm [0.15 + 2/\Delta\theta] \%$
ULTRAFLOW®	$E_f = \pm [2 + 0.02 q_p/q]$, but not above $\pm 5 \%$	$E_f = \pm [1 + 0.01 q_p/q] \%$
Sensor pair	$E_t = \pm [0.5 + 3 \Delta\theta \text{ min}/\Delta\theta] \%$	$E_t = \pm [0.4 + 4/\Delta\theta] \%$

MULTICAL® 803 and ULTRAFLOW® $q_p 1.5 \text{ m}^3/\text{h}$ @ $\Delta\theta 30\text{K}$

Total typical accuracy of MULTICAL® 803, sensor pair and ULTRAFLOW® compared to EN 1434-1.


— $E_c+E_t+E_f$ (EN) - - $E_c+E_t+E_f$ (Typ)

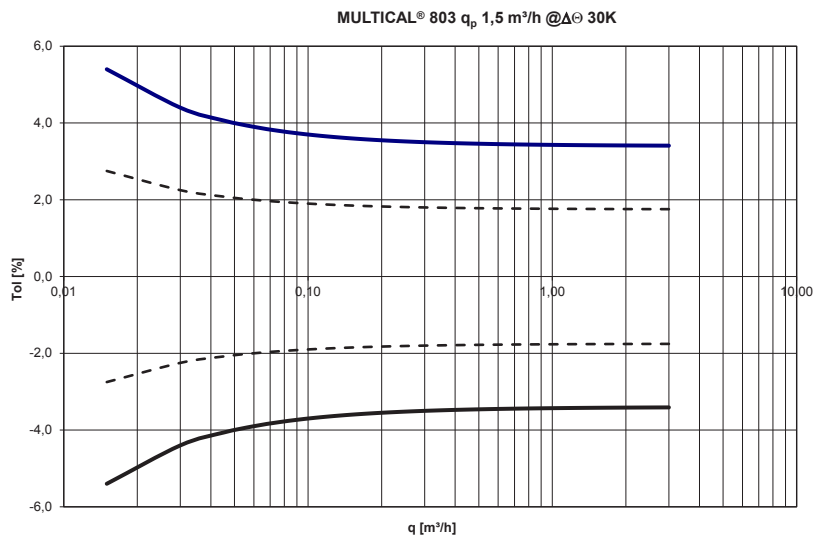


Dimensioned sketches

All measurements in [mm].


Mechanical measurements of MULTICAL® 803 calculator

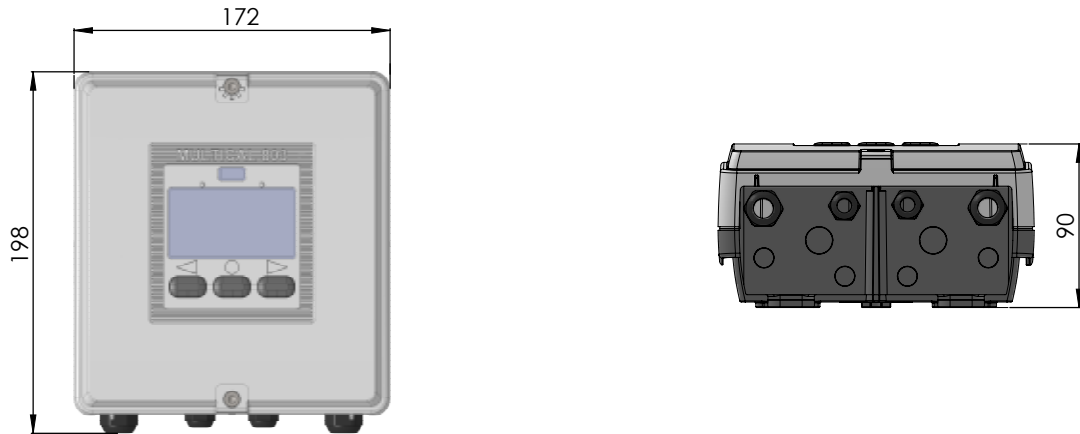

Calculator base

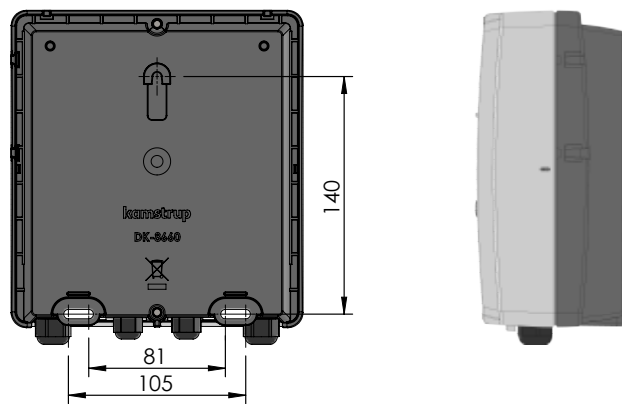

MULTICAL® 803 mounted on ULTRAFLOW® with G $\frac{3}{4}$ x 110 mm threaded connection

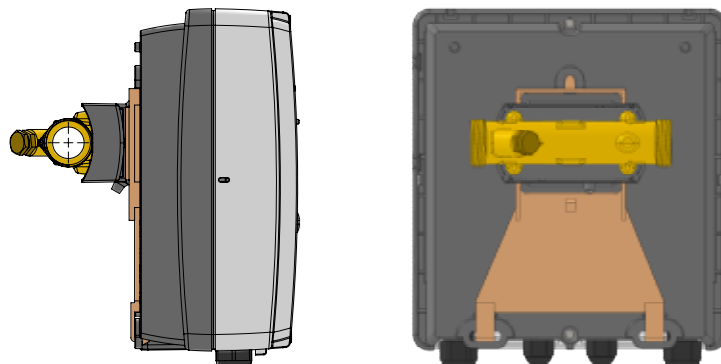

Electrical data

Calculator data

Display	LCD – 7 or 8 digits, 10 mm digit height
Resolutions	999.9999 - 9999.999 – 99999.99 – 999999.9 – 9999999 9999.9999 - 99999.999 – 999999.99 – 9999999.9 – 99999999
Energy units	MWh – kWh – GJ – Gcal
Data logger (EEPROM)	Configurable Logging intervals: From 1 minute to 1 year Logger contents: All registers can be selected Standard logger profile: 20 years, 36 months, 460 days, 1400 hours
Info logger (EEPROM)	280 info codes (the latest 50 info codes are shown in the display)
Clock/calender (with backup battery)	Clock, calendar, leap year compensation, target date
Daylight saving time/wintertime (DST)	Configurable This function can be disabled so that "technical normal time" is used
Clock accuracy	Without external adjustment: Less than 15 min./year With external adjustment every 48 hours: Less than 7 s from legal time
Data communication	KMP protocol with CRC16 used for optical communication and for modules
Power in temperature sensors	< 10 μ W RMS
Power supply	3.6 VDC \pm 0.1 VDC
Backup battery	3.6 VDC, 2 x A lithium
Mains supply	230 VAC +15/-30 %, 50/60 Hz 24 VAC \pm 50 %, 50/60 Hz or 24 VDC +75/-25 %
Insulation voltage	3.75 kV
Power consumption	< 1 W for type 803-0000000-A and b < 7 W for type 803-0000000-C and d

Electrical data

Temperature measurement	t1 Inlet	t2 Outlet	t3 Con- trol	t4 Extra	$\Delta\Theta$ (t1-t2) Heat measurement	$\Delta\Theta$ (t2-t1) Cooling measurement	t5 Preset for A1 and A2
Measuring range	0.00...185.00 °C (t1 and t2: approved for 2.00...180.00 °C)						
Offset adjustment	± 0.99 K joint zero point adjustment for t1, t2, t3 and t4 Note: The offset adjustment is only active on measured temperatures. For example, if t3 has been selected for a preset value, the offset adjustment will not influence the preset value.						
Max cable lengths (max \varnothing 6 mm cable)	Pt100, 2-wire	Pt100, 4-wire	Pt500, 2-wire	Pt500, 4-wire			
	2 x 0.25 mm ² : 2.5 m 2 x 0.50 mm ² : 5 m 2 x 1.00 mm ² : 10 m	4 x 0.25 mm ² : 100 m	2 x 0.25 mm ² : 10 m	4 x 0.25 mm ² : 100 m			
Flow measurement V1/V2	ULTRAFLOW® V1: 9-10-11 V2: 9-69-11	Reed switches V1: 10-11 V2: 69-11	FET switches V1: 10-11 V2: 69-11	24 V active pulses V1: 10B-11B			
CCC code	1xx-2xx-4xx-5xx-8xx	0xx	9xx	2xx and 9xx			
EN 1434 pulse class	IC	IB	IB	(IA)			
Pulse input	680 k Ω pull-up to 3.6 V	680 k Ω pull-up to 3.6 V	680 k Ω pull-up to 3.6 V	12 mA at 24 V			
Pulse ON	< 0.4 V in > 1 ms	< 0.4 V in > 300 ms	< 0.4 V in > 30 ms	< 4 V in > 3 ms			
Pulse OFF	> 2.5 V in > 4 ms	> 2.5 V in > 100 ms	> 2.5 V in > 70 ms	> 12 V in > 4 ms			
Pulse frequency	< 128 Hz	< 1 Hz	< 8 Hz	< 128 Hz			
Integration frequency	< 1 Hz	< 1 Hz	< 1 Hz	< 1 Hz			
Electrical isolation	No	No	No	2 kV			
Max cable length	10 m	10 m	10 m	100 m			
Max cable length with Cable Extender Box, Type 66-99-036	30 m	30 m	30 m	-			
Pulse inputs In-A/In-B	Electronic switch			Reed switch			
Pulse input	680 k Ω pull-up to 3.6 V			680 k Ω pull-up to 3.6 V			
Pulse ON	< 0.4 V in > 30 ms			< 0.4 V in > 500 ms			
Pulse OFF	> 2.5 V in > 30 ms			> 2.5 V in > 500 ms			
Pulse frequency	< 3 Hz			< 1 Hz			
Electrical isolation	No			No			
Max cable length	25 m			25 m			
Requirements to external contact	Leakage current at function open < 1 μ A						
Pulse outputs Out-C/Out-D	HC-003-11 (before 2017-05) HC-003-21/-31 (before 2018-04)			HC-003-11 (after 2017-05) HC-003-21/-31 (after 2018-04)			
Pulse output type	Open collector (OB)			Opto FET			
External voltage	5...30 VDC			1...48 VDC/VAC			
Current	< 10 mA			< 50 mA			
Residual stress	U _{CE} \approx 1 V at 10 mA			R _{ON} \leq 40 Ω			
Electrical isolation	2 kV			2 kV			
Max cable length	25 m			25 m			

Product variants

MULTICAL® 803 type number		Static data Written on the meter's front 803-X-X-XX-	Dynamic data Meter Shown on the display X-XX-X-	Dynamic data Module Shown on the display XX-XX-XX-XX
Type 803-		□ - □ - □□	□ - □□ - □	□□ - □□ - □□ - □□
Calculator type				
Pt100/Pt500 2/4-wire, t1-t2-t3-t4. V1-V2, backlit display		A		
Meter type				
Heat meter	MID module B+D		2	
Heat/cooling meter	MID module B+D & TS 27.02	θ _{HC} = OFF	3	
Heat meter	National approval		4	
Cooling meter	TS 27.02+BEK1178		5	
Heat/cooling meter	MID module B+D & TS 27.02	θ _{HC} = ON	6	
Volume meter, hot			7	
Volume meter, cold			8	
Energy meter			9	
Country code				
Determined by Kamstrup upon placement of order			XX	
Flow sensor connection type				
Delivered with one ULTRAFLOW®			1	
Delivered with two identical ULTRAFLOW®			2	
Prepared for one ULTRAFLOW®			7	
Prepared for two identical ULTRAFLOW®			8	
Prepared for flow sensor with fast and bounce-free electronic pulses			C	
Prepared for flow sensor with slow and bounce-free electronic pulses			J	
Prepared for flow sensor with slow pulses with bounce			L	
Prepared for flow sensor with 24 V active pulses			P	
Temperature sensor set				
Supplied without temperature sensors			00	
2-wire Pt500 temperature sensors				
Direct short temperature sensors, 2 pcs.	DS 27.5 mm	L 1.5 m - 3.0 m	1x	
Direct short temperature sensors, 2 pcs.	DS 38.0 mm	L 1.5 m - 3.0 m	2x	
Pocket temperature sensors, 2/3 pcs.	PL ø5.8 mm	L 1.5 m - 10 m	3x	
2-wire Pt100 temperature sensors				
Direct short temperature sensors, 2 pcs	DS 27.5 mm or DS 38.0 mm	L 2.0 m	Jx	
4-wire Pt500/Pt100 temperature sensors				
Pocket temperature sensors with connection head, 2 pcs.	PL ø6.0 mm	L 105 mm - 230 mm	Ax	
Pocket temperature sensors with connection head, 2 pcs.	PL ø5.8 mm	L 90 mm - 180 mm	Bx	
Supply modules				
1 x 230 VAC	supply of 2 communication modules [M1+M2]		A	
1 x 24 VAC/VDC	supply of 2 communication modules [M1+M2]		b	
2 x 230 VAC	supply of 4 communication modules [M1+M2+M3+M4]	1 x 24 VDC auxiliary supply	C	
2 x 24 VAC/VDC	supply of 4 communication modules [M1+M2+M3+M4]	1 x 24 VDC auxiliary supply	d	

Product variants

MULTICAL® 803 type number	Static data Written on the meter's front 803-X-X-XX-	Dynamic data Meter Shown on the display X-XX-X-	Dynamic data Module Shown on the display XX-XX-XX-XX			
			M1	M2	M3	M4
Type 803- □ - □ - □□ - □ - □□ - □ - □□ - □□ - □□ - □□ - □□						
Communication module (4 module slots)			M1	M2	M3	M4
No module			00	00	00	00
Data + 2 pulse inputs (In-A, In-B)			10	10	10	10
Data + 2 pulse outputs (Out-C, Out-D)			11	11	11	11
M-Bus, configurable + 2 pulse inputs (In-A, In-B)			20	20	20	20
M-Bus, configurable + 2 pulse outputs (Out-C, Out-D)			21	21	21	21
M-Bus, configurable w/ Thermal Disconnect *			22	22	22	22
Wireless M-Bus, configurable, 868 MHz + 2 pulse inputs (In-A, In-B)			30	30		
Wireless M-Bus, configurable, 868 MHz + 2 pulse outputs (Out-C, Out-D)			31	31		
Analog outputs 0/4...20 mA *					40	40
Analog inputs 4...20 mA or 0...10 V					41	
PQT Controller *					43	
Kamstrup Radio (low-power) + 2 pulse inputs (In-A, In-B)			50	50		
Kamstrup Radio GDPR (low-power) + 2 pulse inputs (In-A, In-B)			51	51		
LON TP/FT-10 + 2 pulse inputs (In-A, In-B)			60	60	60	60
BACnet MS/TP + 2 pulse inputs (In-A, In-B) *			66	66	66	66
Modbus RTU (RS-485) + 2 pulse inputs (In-A, In-B) *			67	67	67	67
2G/4G network module + 2 pulse inputs (In-A, In-B)			80	80		
Modbus/KMP TCP/IP + 2 pulse inputs (In-A, In-B)			82	82	82	82
High Power Radio Router + 2 pulse inputs (In-A, In-B)			84	84		
High Power Radio Router GDPR + 2 pulse inputs (In-A, In-B)			85	85		

* The meter must be mains supplied

Please contact Kamstrup A/S for further information about product variants.

Meter configuration

	A	B	CCC	DDD	EE	FF	GG	L	M	N	PP	RR	T	VVV
Flow sensor position														
Inlet		3												
Outlet		4												
Measuring unit														
GJ		2												
kWh		3												
MWh		4												
Gcal		5												
Auto Detect CCC codes (ULTRAFLOW® x4)														
Normal resolution (7 digits)			807											
High resolution (8 digits)			818											
Static CCC codes														
Reed contact (7 digits)			0xx											
Electronic, fast pulses (7 digits)			1xx											
Electronic, fast pulses (8 digits)			2xx											
Kamstrup, UF X4 (7 digits)			4xx											
Kamstrup, UF X4 (8 digits)			5xx											
Electronic, slow pulses (7 digits)			9xx											
Display														
Heat meter (standard)				210										
Heat/cooling meter (standard)				310										
Cooling meter (standard)				510										
Tariffs														
No active tariff					00									
Power tariff					11									
Flow tariff					12									
t1-t2 tariff					13									
Inlet tariff					14									
Outlet tariff					15									
Time-controlled tariff					19									
Heat/cooling volume tariff					20									
PQ tariff					21									
Pulse inputs In-A/In-B														
10 m³/h, 10 l/imp, pre-counter 1 (standard)						24	24							
Integration mode														
Fast mode (2 s)			Display on							4				
Fast mode (2 s)			Display and backlight on							9				
Leakage limits (V1/V2)														
OFF														0
1.0 % of q _p + 20 % of q														1
1.0 % of q _p + 10 % of q														2
0.5 % of q _p + 20 % of q														3
0.5 % of q _p + 10 % of q														4
Cold water leakage limits (In-A/In-B)														
OFF														0
30 min. without pulses														1
One hour without pulses														2
Two hours without pulses														3

Meter configuration

A - B - CCC - DDD - EE - FF - GG - L - M - N - PP - RR - T - VVVV

Pulse outputs Out-C/Out-D

Out-C: V1/4	5 ms	73
Out-C: V1/4 Out-D: V2/1	3.9 ms	80
Out-C: V1/1	3.9 ms	82
Out-C: V1/4	22 ms	83
E1 and V1 or E3 and V1	10 ms	94
E1 and V1 or E3 and V1	32 ms	95
E1 and V1 or E3 and V1	100 ms (0.1 s)	96
Controlled output based on data commands		99

Data logger profile

Standard data logger profile	10
------------------------------	----

Encryption level

Common key	2
Individual key	3

Customer label

Serial number	0000
---------------	------

Please contact Kamstrup A/S for further information about meter configuration.

Information code types in display

Display digit								Description
1	2	3	4	5	6	7	8	
Info	t1	t2	t3	V1	V2	In-A	In-B	
1								Supply voltage interrupted
2								The meter is supplied by the backup battery
9								External alarm (e.g. via KMP)
	1							t1 above measuring range or switched off
		1						t2 above measuring range or switched off
			1					t3/t4 above measuring range or switched off
	2							t1 below measuring range or short-circuited
		2						t2 below measuring range or short-circuited
			2					t3/t4 below measuring range or short-circuited
	9	9						t1-t2 Invalid temperature difference
				1				V1 Communication error
					1			V2 Communication error
					2			V1 Wrong pulse figure
					2			V2 Wrong pulse figure
					3			V1 Air
					3			V2 Air
					4			V1 Wrong flow direction
					4			V2 Wrong flow direction
					6			V1 Increased flow (flow1 > qs, for more than 1 hour)
					6			V2 Increased flow (flow2 > qs, for more than 1 hour)
					7			V1/V2 Burst, water loss (flow1 > flow2)
					7			V1/V2 Burst, water penetration (flow1 < flow2)
					8			V1/V2 Leakage, water loss (M1 > M2)
					8			V1/V2 Leakage, water penetration (M1 < M2)
						7		In-A2 Leakage in the system
						8		In-A1 Leakage in the system
						9		In-A1/A2 External alarm
							7	In-B2 Leakage in the system
							8	In-B1 Leakage in the system
							9	In-B1/B2 External alarm

Example:

1	0	2	0	6	7	9	9
---	---	---	---	---	---	---	---

Note: Info codes are configurable. Therefore, it is not certain that all the parameters to the left are available in a given MULTICAL® 803.

An info logger saves the info code every time the info code is changed. It is possible to read the latest 280 changes of the information code as well as the dates of the changes.

Accessories

Article number	Description
HC-993-10	Backup battery, 2xA-cells
HC-993-11	230 VAC supply module
HC-993-12	24 VAC/VDC supply module
HC-993-13	230 VAC til 24 VDC auxiliary supply module
HC-993-14	24 VAC/VDC til 24 VDC auxiliary supply module
3026-517	Sealing cap for temperature sensors, blue 2 pcs.
3026-518	Sealing cap for temperature sensors, red 2 pcs.
3026-657	Bracket for ULTRAFLOW®
5000-337	Module cable, 2 m (2 x 0.25 mm ²)
6699-035	USB module configuration cable
6699-036	Cable Extender Box
6699-042	Metal plate for optical read-out head (20 pcs)
6699-099	Infrared optical reading head w/USB plug
6699-102	Infrared optical reading head w/D-sub plug
6699-403	230/24 VAC safety transformer 5 VA
6699-404	230/24 VAC safety transformer 10 VA
6699-405	230/12/24 VAC safety transformer 63 VA
6699-447.E	Internal antenna for Kamstrup radio, 434 MHz
6699-448	Mini Triangle antenna for Wireless M-Bus and 2G/4G Network Module
6699-482.E	Internal antenna for Wireless M-Bus 868 MHz
6699-724	METERTOOL HCW
6699-725	LogView HCW

Calibration units

Article number	Description
6699-361	2/4-wire Pt500, heat/cooling (used with METERTOOL HCW)
6699-362	2/4-wire Pt100, heat/cooling (used with METERTOOL HCW)

Find more information on ULTRAFLOW®, temperature sensors and ball valves on products.kamstrup.com.

Please contact Kamstrup A/S for information about further accessories.

Kamstrup A/S

Industrivej 28, Stilling
 DK-8660 Skanderborg
 T: +45 89 93 10 00
 F: +45 89 93 10 01
 info@kamstrup.com
 kamstrup.com